




Martin Enterprises

EMS Marker Disclaimer

Martin Enterprises offers a complete line of EMS Marker options for your grade level and buried utility enclosure. The Martin Enterprises EMS Marker is incorporated into the underground utility enclosure. The utility and installation environment should be considered when selecting an EMS Marker. Please use the following diagram to select the proper EMS Marker.

Product No.	Description	Frequency Range	Utility
5015GLM	Grade Level Marker	0-18 Inches	Telephone/Broadband
5015BGM	Below Grade Marker	1-5 Feet	Telephone/Broadband
7022GLM	Grade Level Marker	0-18 Inches	Power
7022BGM	Below Grade Marker	1-5 Feet	Power
2013GLM	Grade Level Marker	0-18 Inches	Water/Sewer
2013BGM	Below Grade Marker	1-5 Feet	Water/Sewer
1011GLM	Grade Level Marker	0-18 Inches	Gas
1011BGM	Below Grade Marker	1-5 Feet	Gas

Martin Enterprises does not take responsibility for frequency range issues caused by improper EMS Marker selection.

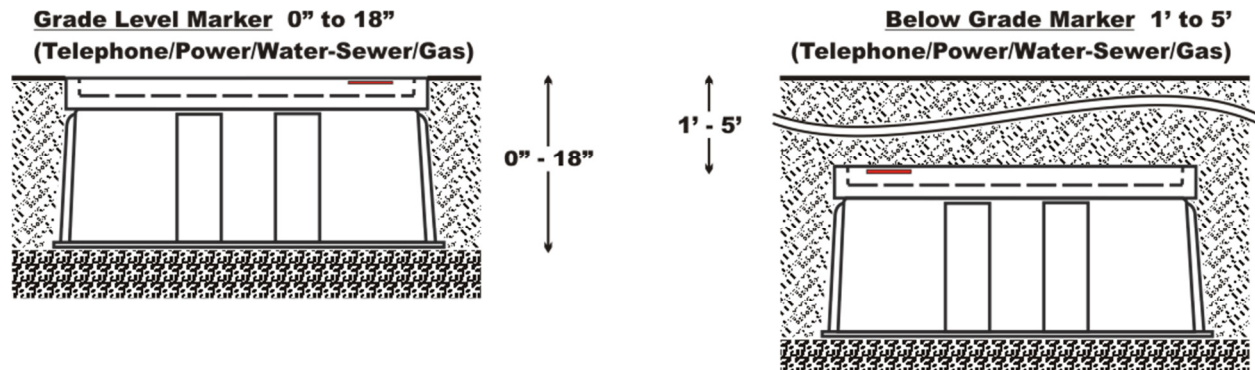

A3395US

7231 Boulder Ave. #262 Highland, CA 92346 / Tel 1.951.928.8713 / Fax 1.951.928.4623 martinfrp@sbcglobal.net